

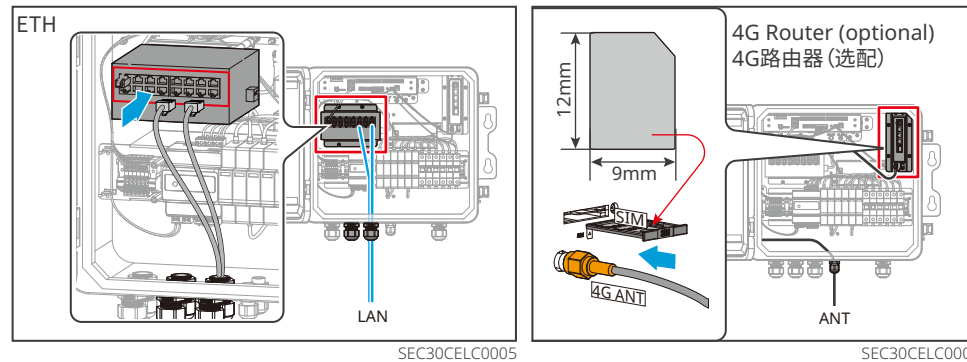
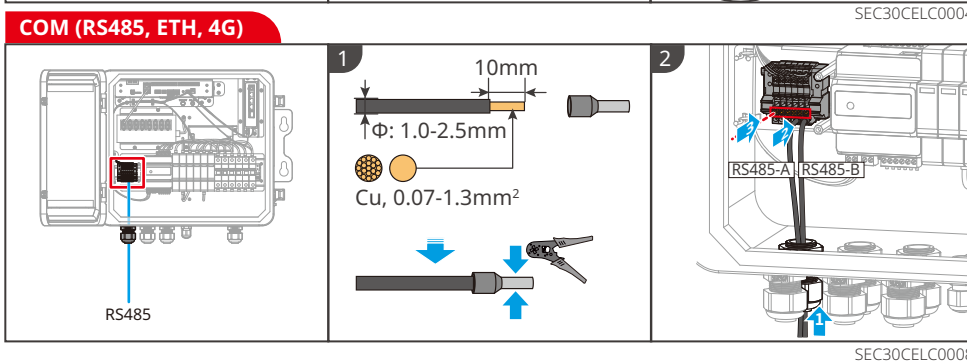
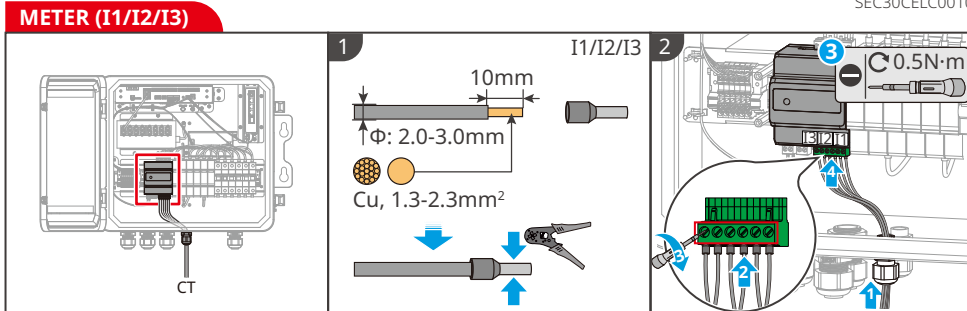
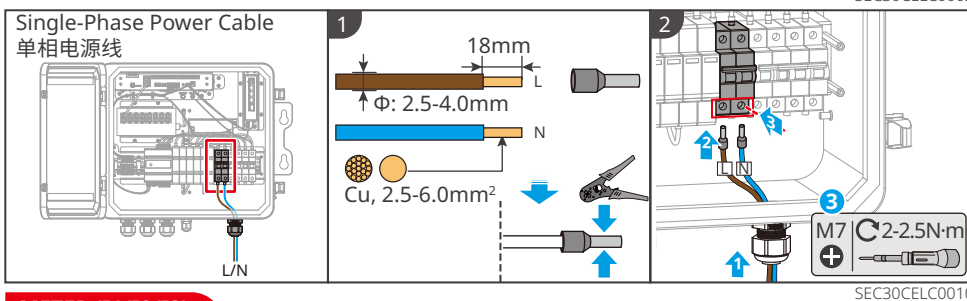
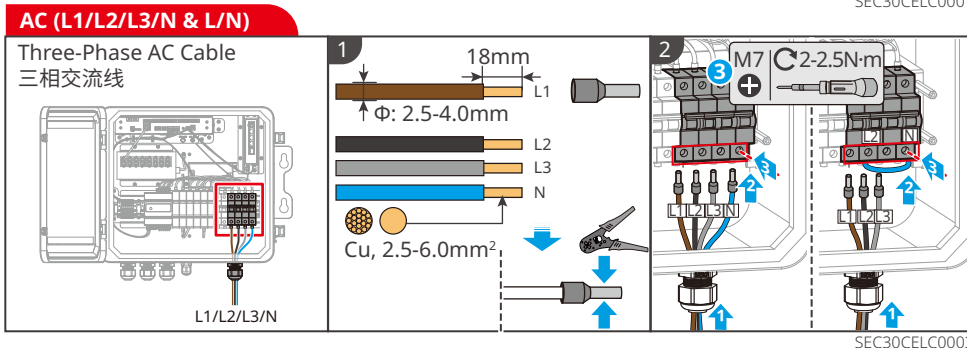
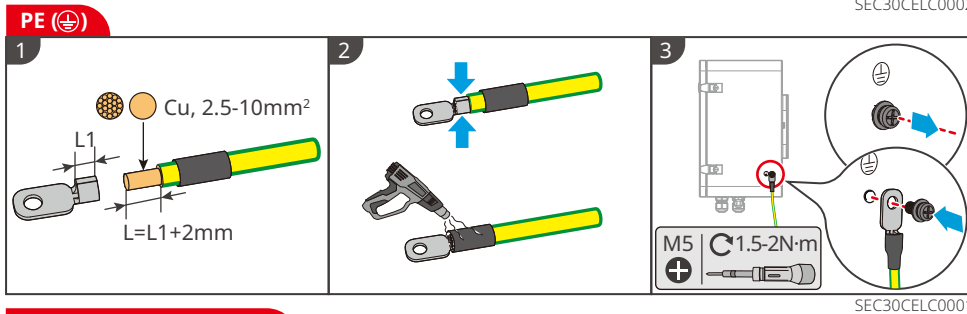


Procedure


2 CS Elektrické připojení **DE** Elektroanschluss **EN** Electrical Connection
ES Conexión eléctrica **FR** Raccordement électrique **HU** Elektomos csatlakozás
IT Allacciamento elettrico **NL** Elektrische aansluiting **PL** Połączenie elektryczne
PT Ligação elétrica **ZH** 电气连接

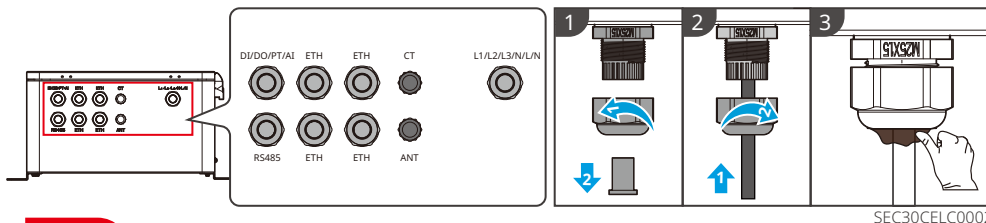



Install the Cover / 安装挡板

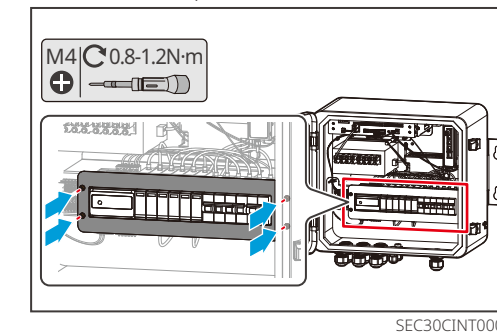


Close the Cabinet Door / 关闭柜门

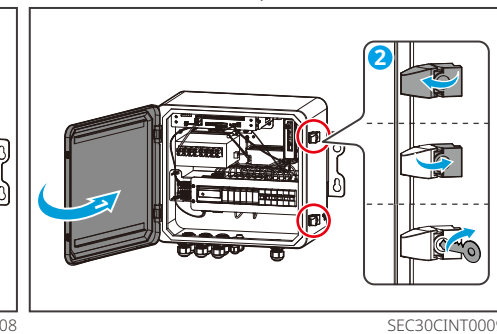




Temp. sensor/温度传感器

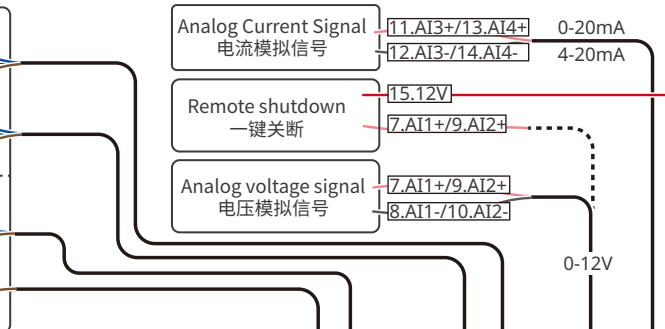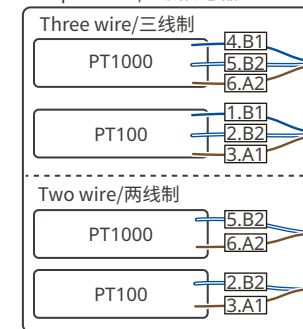

NC&COM Normally closed 常闭

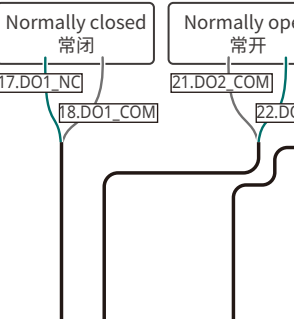

NO&COM Normally open 常开

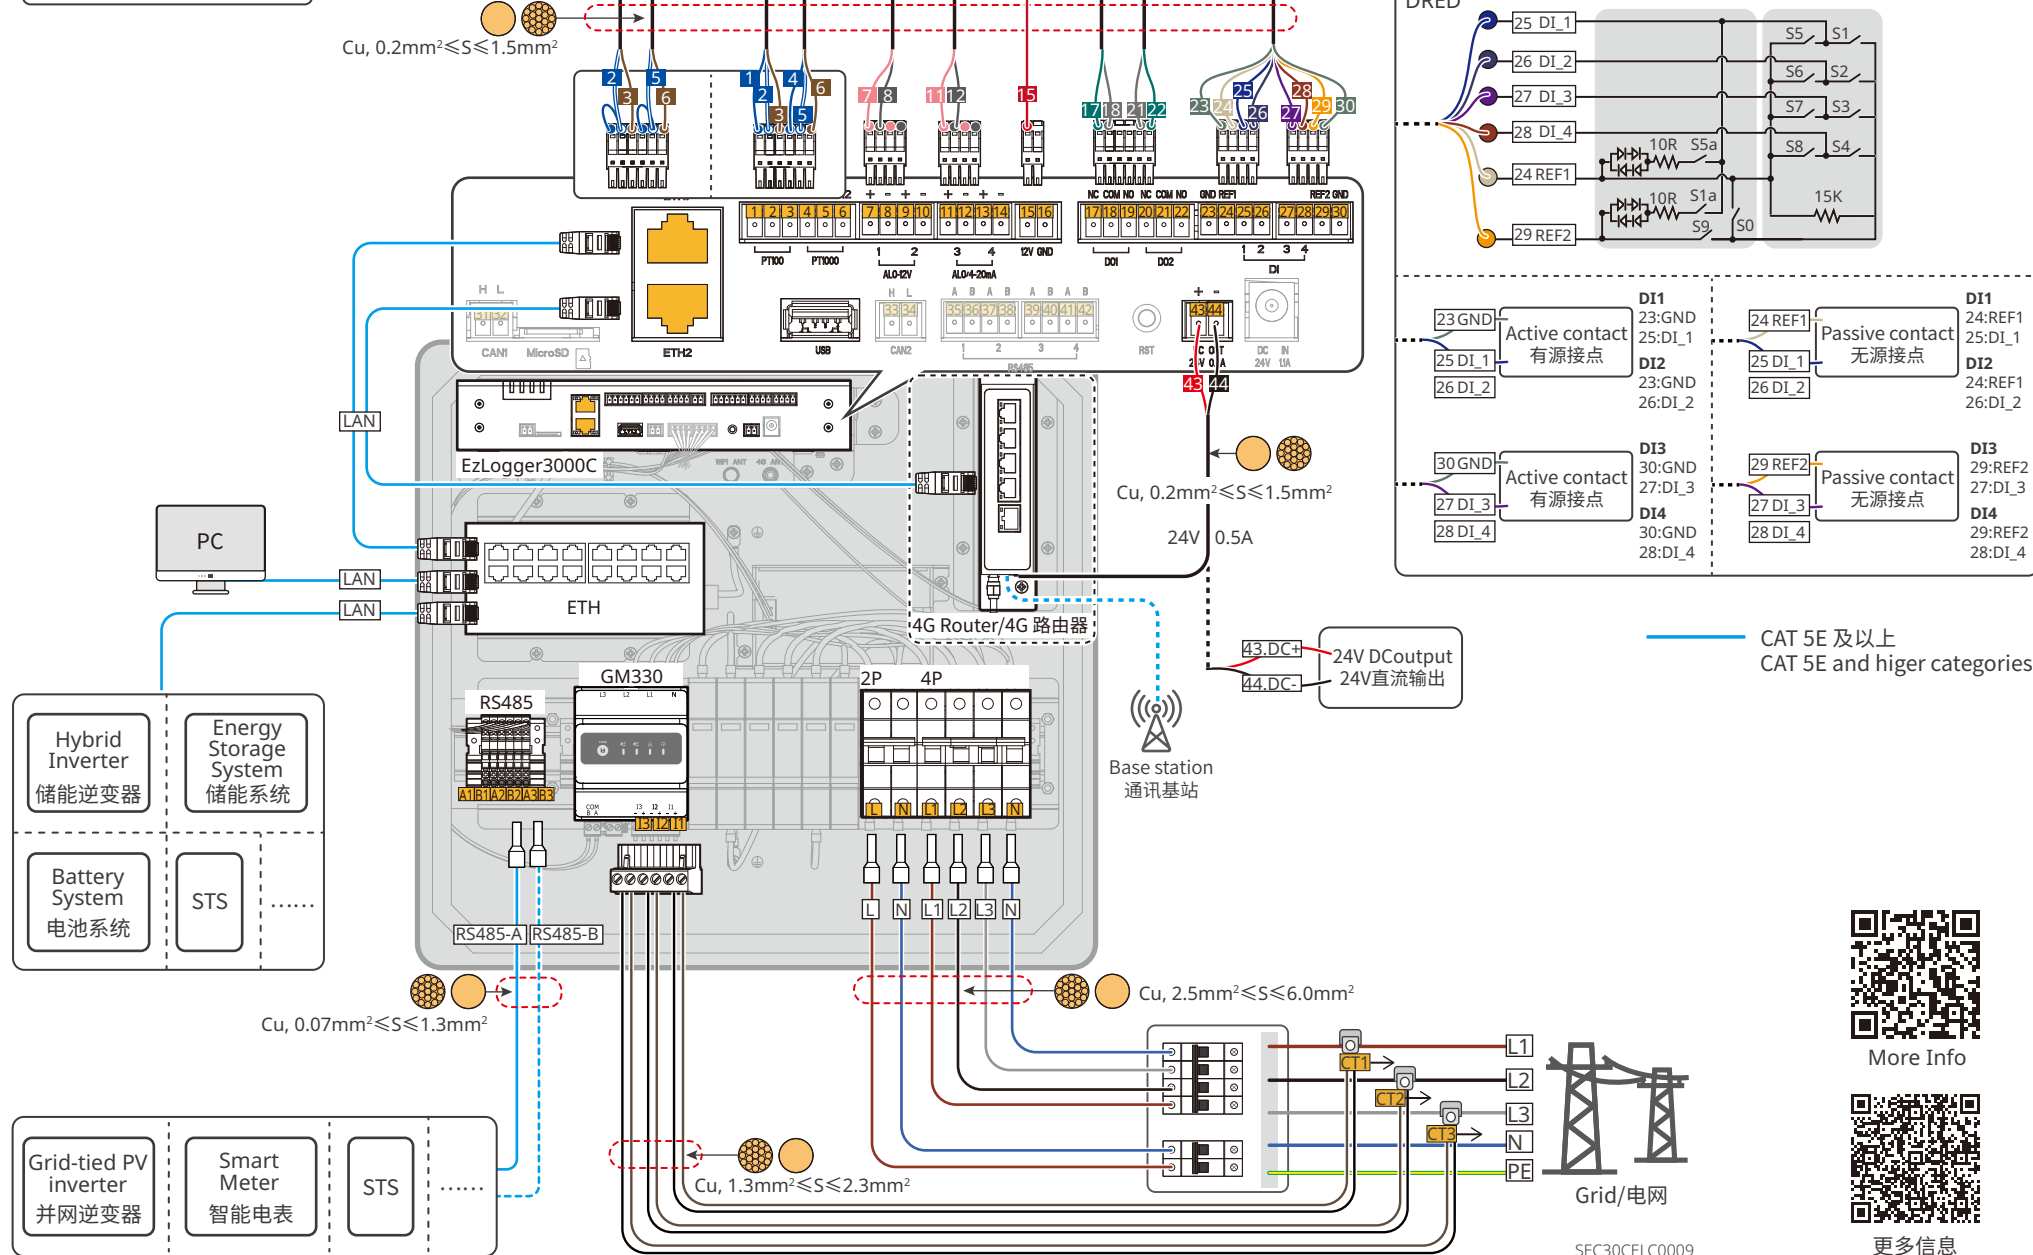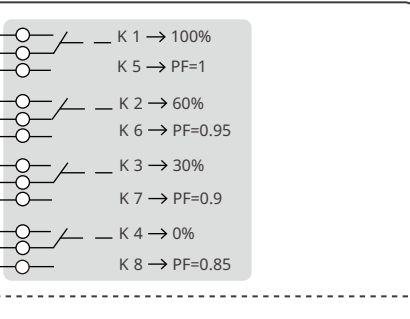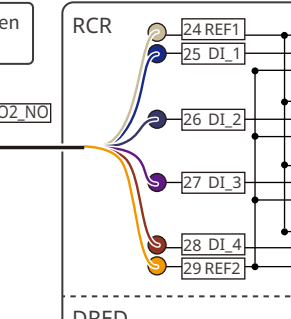

CAT 5E 及以上
CAT 5E and higher categories



More Info



更多信息

Grid/电网

SEC30CELC0009